





CABLE SELECTION CHARTS

To determine the cable diameter take note that the voltage losses should not exceed 3%. For your selection take into account all regulations of local electricity supply boards and end users' requirements for an economic operation of the installation.

D.O.L. starting 400V multi-core cable

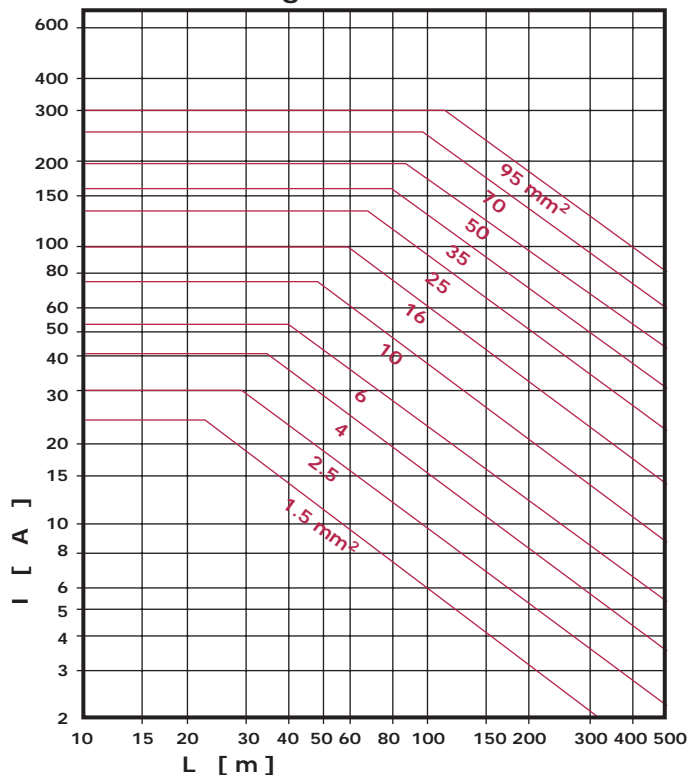

Star Delta starting 400V multi-core cable

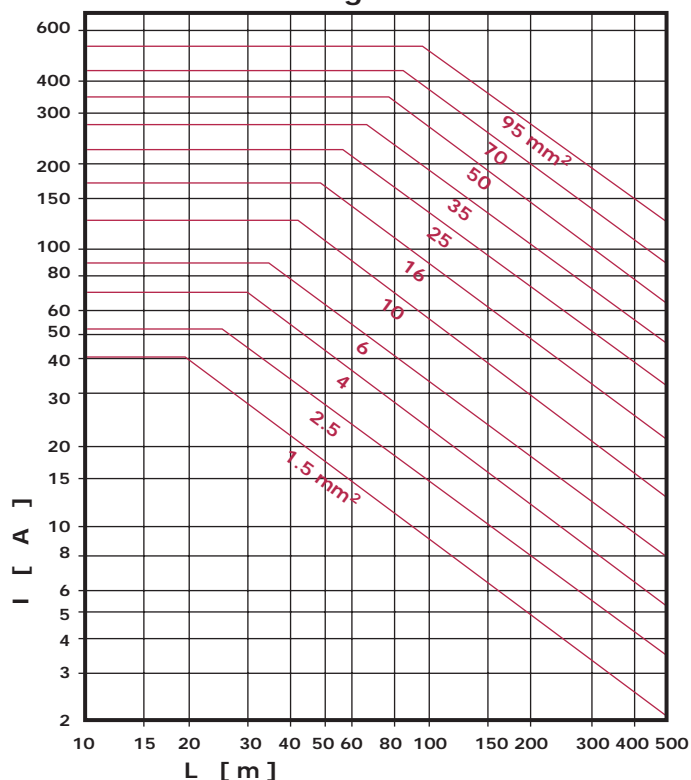

D.O.L. starting 230V multi-core cable

